


Figure 14.1.PS10(a)

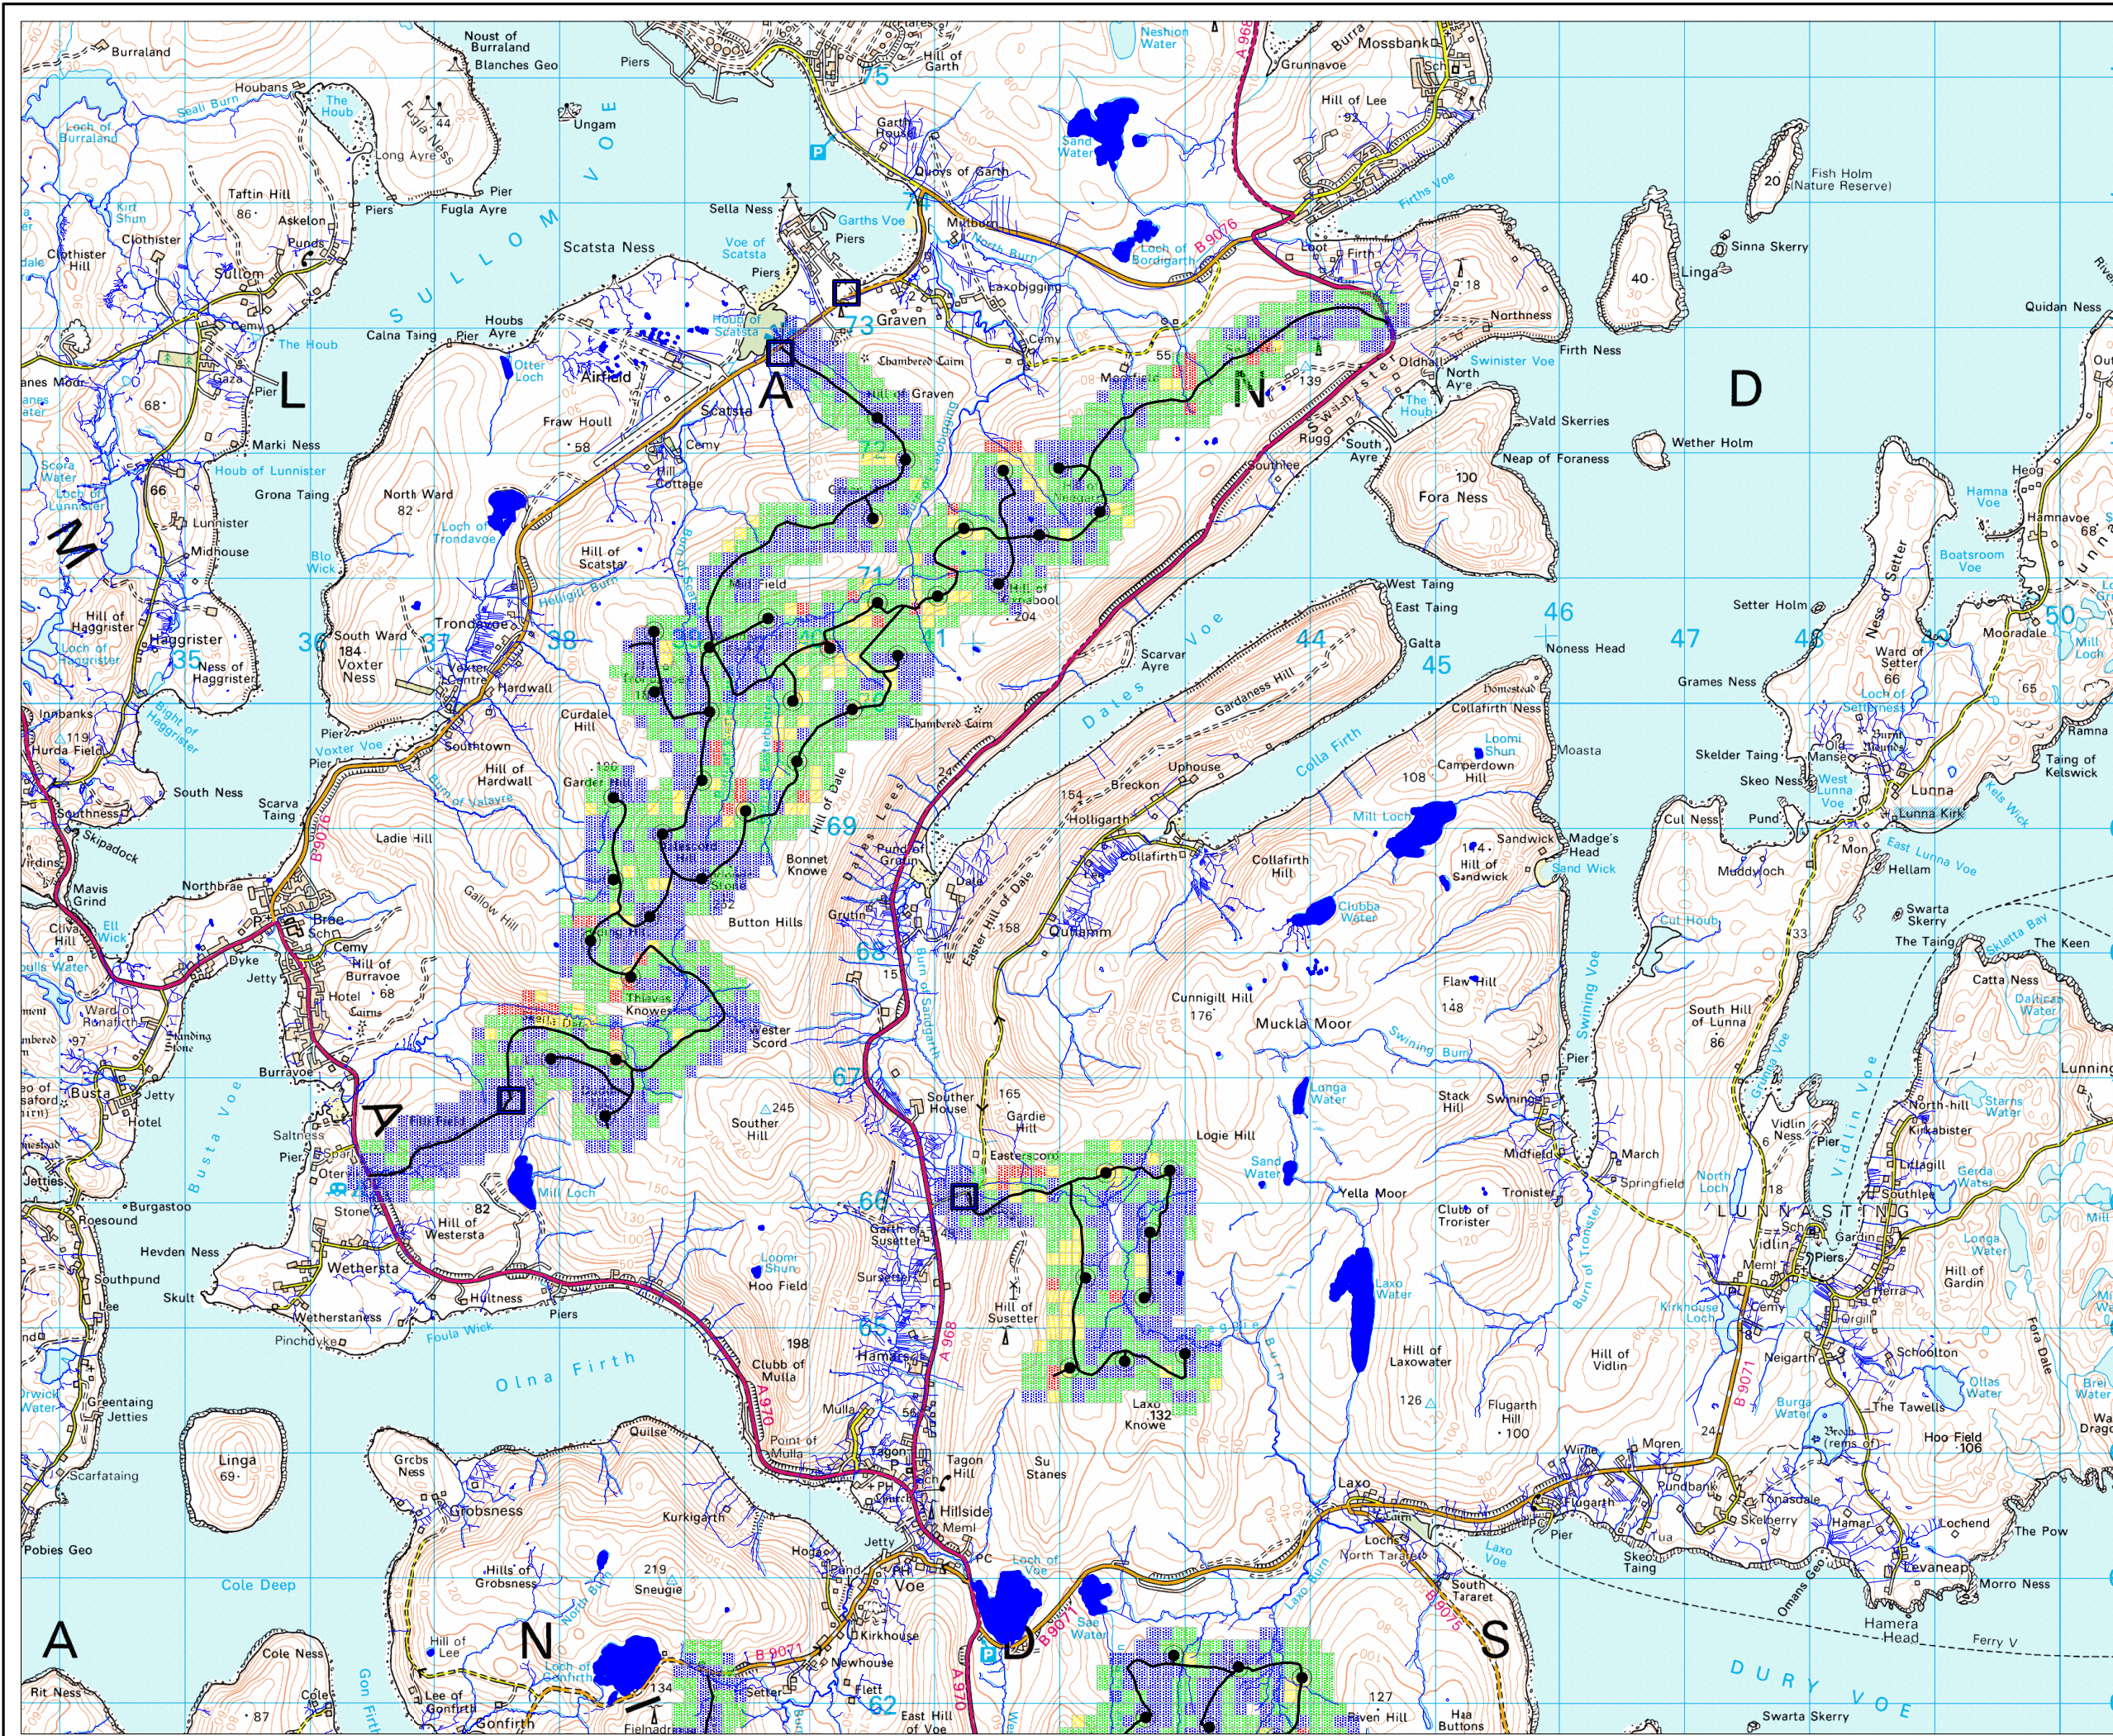


Key

- Proposed turbine location
- Access track (simplified)
- Provisional construction compound location
- Proposed converter station location
- Watercourses
- Waterbodies

Hazard Zonation

- Probable (207)
- Likely (485)
- Unlikely (2645)
- Negligible (1895)

Using 100m x 100m grid cells



Client	 viking energy Harnessing Shetland's natural resources		
Project	Viking Wind Farm		
Title	Hazard Zonation - Delting and Collafirth		
Scale	1:50,000 @ A3	Date	16/01/09



Reproduced by permission of Ordnance Survey on behalf of HMSO. Crown copyright and database right 2008. all rights reserved. Ordnance Survey Licence number 100024344